



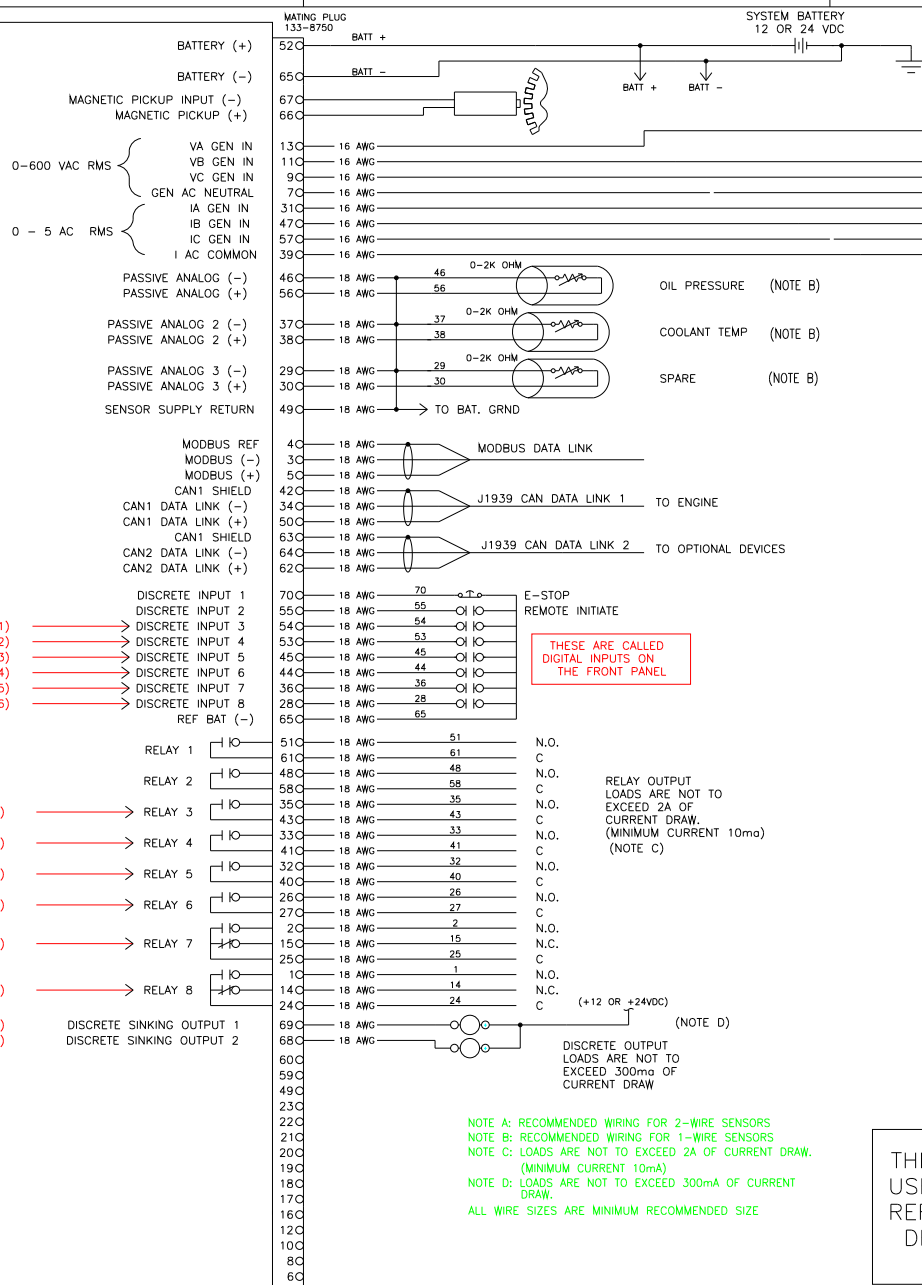


(USE EVENT INPUT 1) → DISCRETE INPUT 1
 (USE EVENT INPUT 2) → DISCRETE INPUT 2
 (USE EVENT INPUT 3) → DISCRETE INPUT 3
 (USE EVENT INPUT 4) → DISCRETE INPUT 4
 (USE EVENT INPUT 5) → DISCRETE INPUT 5
 (USE EVENT INPUT 6) → DISCRETE INPUT 6

(USE DIGITAL SELECTOR 1) → RELAY 1
 (USE DIGITAL SELECTOR 2) → RELAY 2
 (USE DIGITAL SELECTOR 3) → RELAY 3
 (USE DIGITAL SELECTOR 4) → RELAY 4
 (USE DIGITAL SELECTOR 5) → RELAY 5
 (USE DIGITAL SELECTOR 6) → RELAY 6
 (USE DIGITAL SELECTOR 7) → RELAY 7
 (USE DIGITAL SELECTOR 8) → RELAY 8

NOTE A: RECOMMENDED WIRING FOR 2-WIRE SENSORS
 NOTE B: RECOMMENDED WIRING FOR 1-WIRE SENSORS
 NOTE C: LOADS ARE NOT TO EXCEED 2A OF CURRENT DRAW.
 (MINIMUM CURRENT 10mA)
 NOTE D: LOADS ARE NOT TO EXCEED 300mA OF CURRENT DRAW.
 ALL WIRE SIZES ARE MINIMUM RECOMMENDED SIZE

THIS DRAWING SHOULD BE USED AS REFERENCE ONLY. REFER TO INSTALLATION DRAWINGS FOR PROPER WIRING.

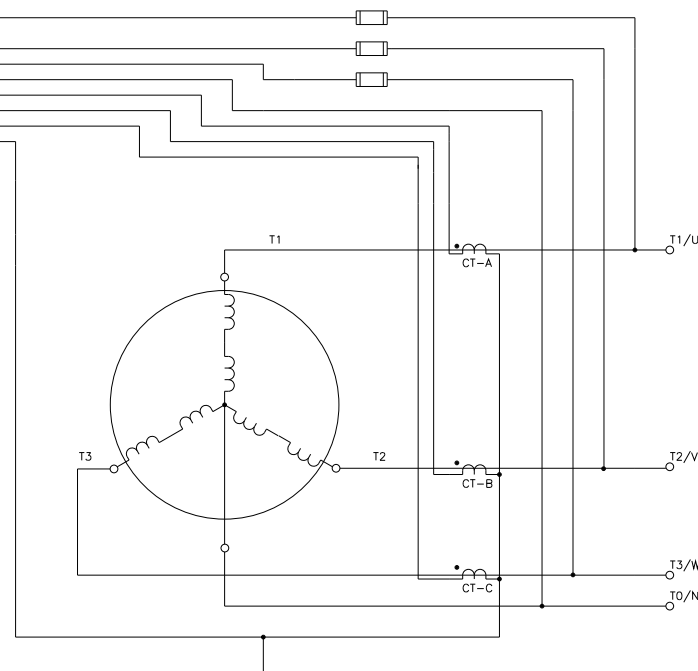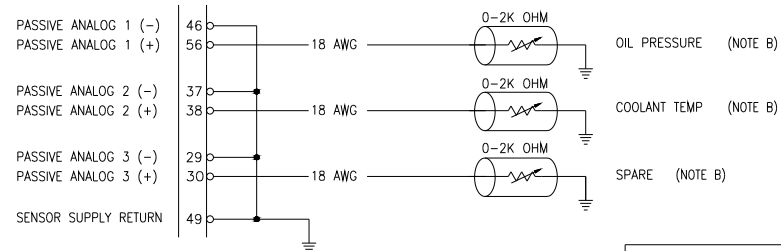

CATERPILLAR®			
BUILDING LC SERVICE TRAINING DEPARTMENT			
THE INFORMATION HEREIN IS THE PROPERTY OF CATERPILLAR INC. AND/OR ITS SUBSIDIARIES. WITHOUT WRITTEN PERMISSION, ANY COPYING, REPRODUCTION, TO OTHERS AND ANY USE EXCEPT THAT FOR WHICH IT IS LOANED IS PROHIBITED.			
GENERAL DESCRIPTION			
EQUIPMENT LOCATION G205	EQUIPMENT NUMBER EMCP3.3.DWG	SHEET NUMBER	
EMCP 3.3 PACKAGE			
DRAWN REM	SCALE	CATERPILLAR DRAWING NUMBER	
DATE 3/05	PLT.	EMCP 3.3 E01	
APPROVED	REVISION		