

GE ZENITH Controls

Inspect and/or Repair the Wiring Harness of an F17

Purpose:	Repair the wiring harness of an F17.
When:	When directed by a service order.

Required Tools & Equipment:

Basic electricians hand tools	PPE
Multimeter Digital or Analog	Rubber insulating gloves class 0
Wiring harness	Safety glasses
Tie wraps	Electrical hazard safety shoes



Danger

HAZARDOUS VOLTAGE
Can Cause Severe Injury or Death

Ensure before the enclosure is opened, you must lockout all energy sources to the ATS.

Do These Steps:

1. *Obtain* the ISO forms:
2. *Open* the enclosure.

Caution: High voltage may cause personal injury or death. Use all required Personal Protective Equipment.

GE ZENITH Controls

3. *Check for proper voltage across all normal source phases.*

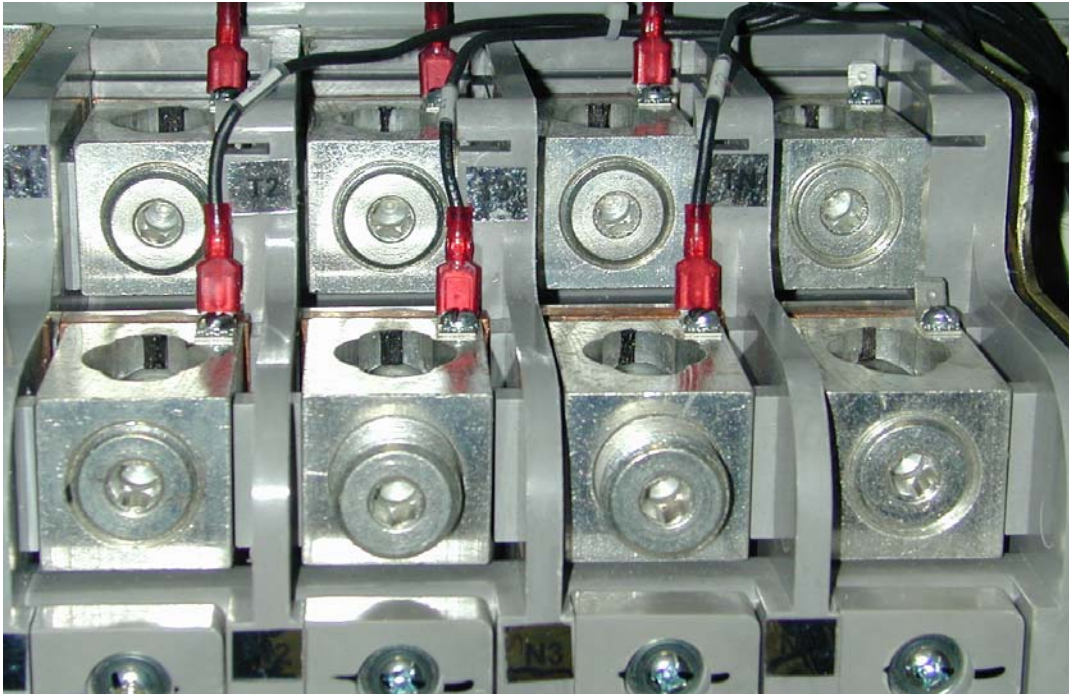


Figure 1.

4. *Check the overall condition of the harness.*
5. *Disconnect plug J7.*
6. *Check for proper voltage at the pins of J7.*

Note: You will need to use the schematic to determine the voltage for each pin.

7. *Remove the J5 harness.*
8. *Check the J5 wiring harness for:*
 - Harness integrity
 - Nicks and Crimp
 - Molex Connections are level in the plug
 - Tie wraps are not too tight.

GE ZENITH Controls

9. *Connect* the J5 plug into the RT box.

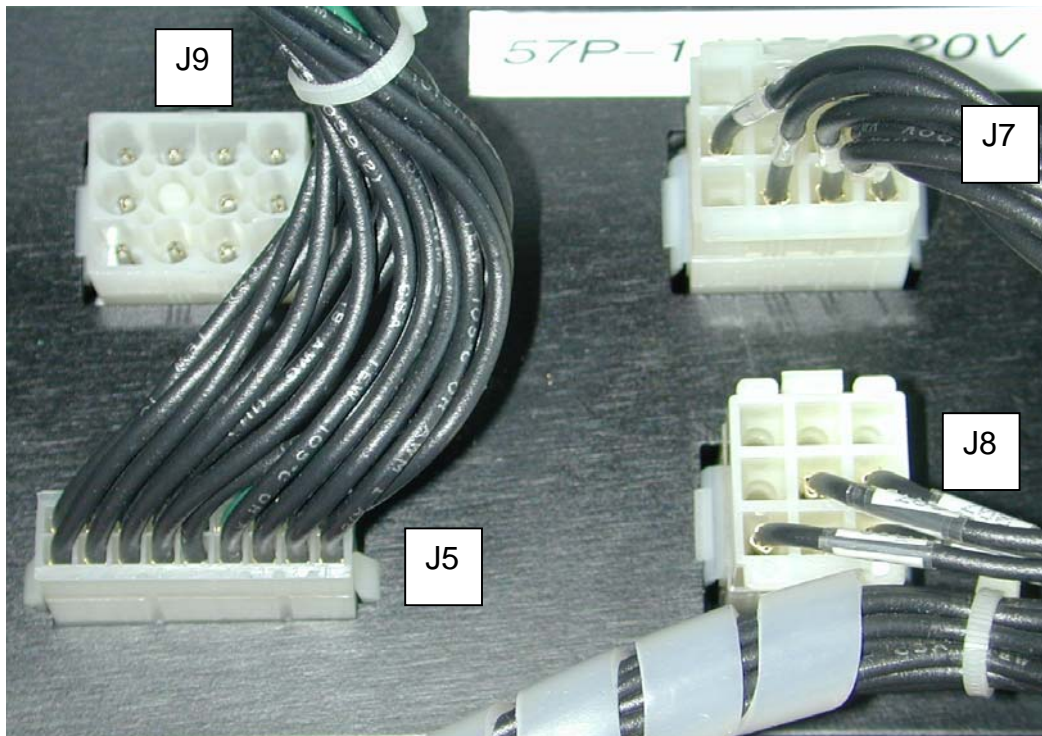


Figure 2.

10. *Check* for proper voltage at the pins of the J5 Plug.

Note: You will need to use the schematic to determine the voltage for each pin.

11. *Connect* the J5 plug in to the microprocessor.



Figure 3.

GE ZENITH Controls

12. *Disconnect* the J6 plug from the microprocessor.



Figure 4.

13. *Check* the pins for proper seating.

14. *Check* the SN/SE micro switch Fast on connections.

15. *Connect* the multimeter to the SN/SE micro switch connection and the appropriate J6 pin.

Note: You will need the schematic diagram to determine the correct J6 pin.

16. *Connect* the J6 plug into the microprocessor.

17. *Determine* next steps.

If the wiring harness is:	Then:
Good	Go to Step 40.
Bad	Continue on.

Replacement of the wiring harness:

GE ZENITH Controls

18. *Disable* the generator start-up circuit.



Danger

HAZARDOUS VOLTAGE

Can Cause Severe Injury or Death

On systems with multiple ATS's connected to a single generator, you will need to lockout all energy sources to the ATS generator before continuing on.

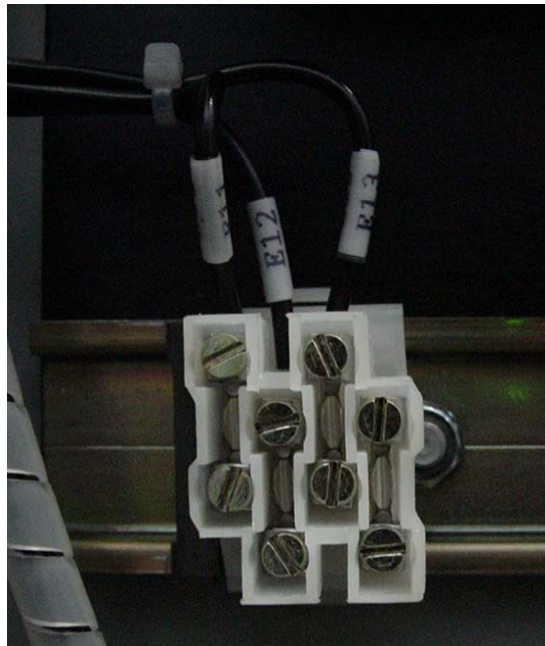


Figure 5.

19. *Disconnect* primary power to the switch.

20. *Check* for zero volts on the normal and emergency power lugs.

21. *Check* the overall condition of the harness.

Look for:
Damage
Burn Marks
Oil/Grease
Water

GE ZENITH Controls

22. Remove the J6, J7 and J8 plugs from the microprocessor, and the RT box.

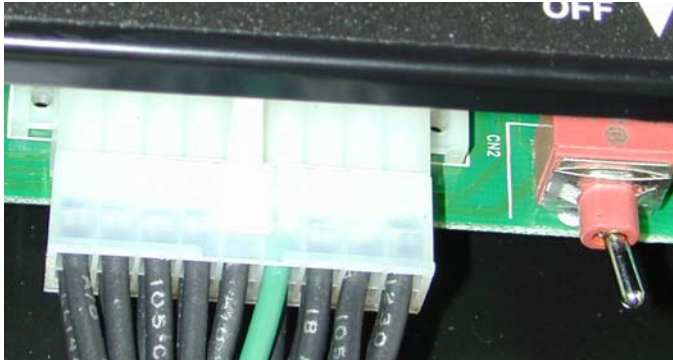


Figure 6.

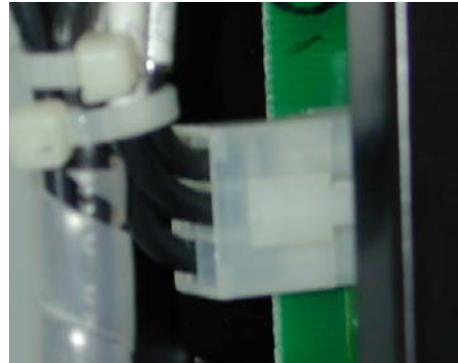


Figure 7.

23. Remove the tie wraps securing the harness.

24. Remove disconnect switch wires, 252A and 25ZZ.

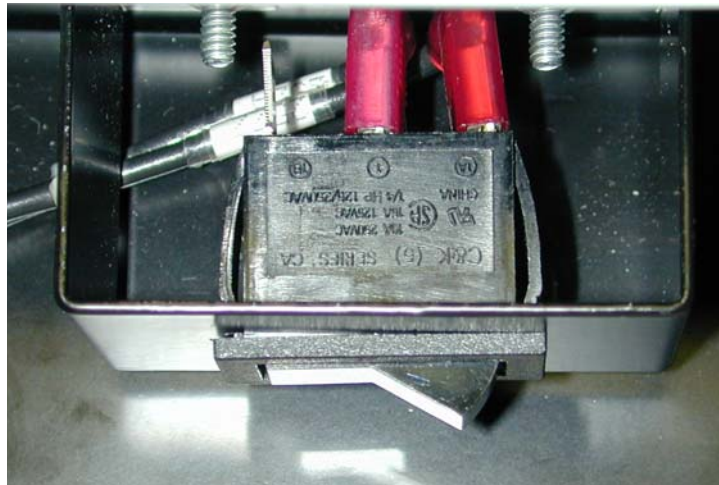


Figure 8.

GE ZENITH Controls

25. Remove wires 14, 15, 16, 20, 21, 22, 30, 31, and 32 from power lugs.

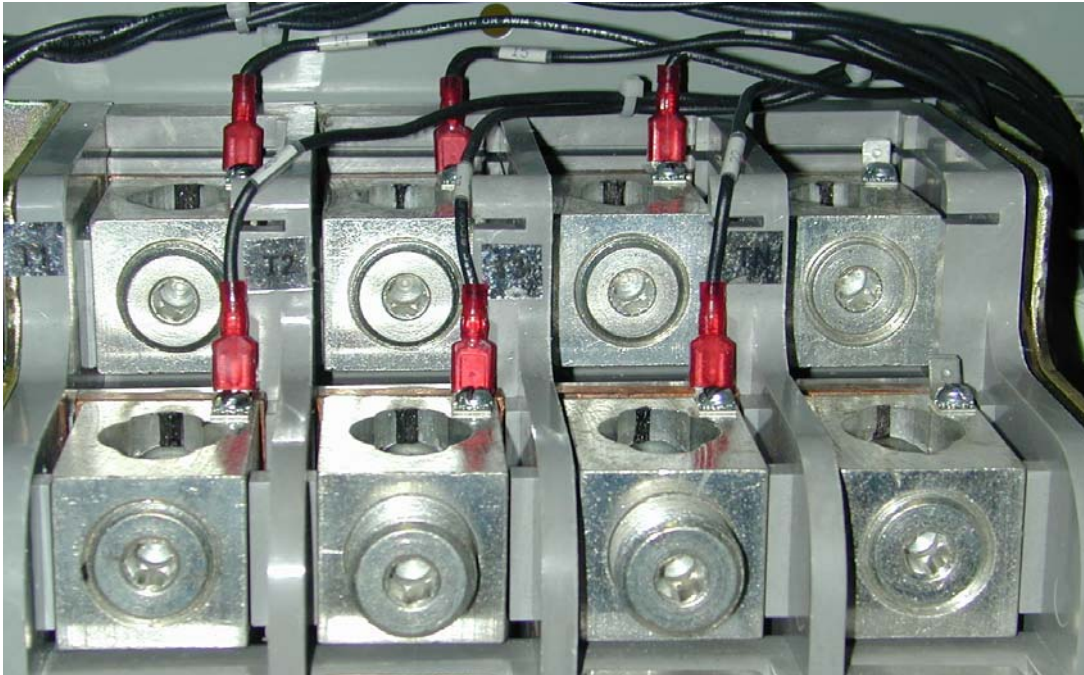


Figure 9.

GE ZENITH Controls

26. Remove wires 252A, 25ZZ, 26, 36, SN and SE from the micro switch.

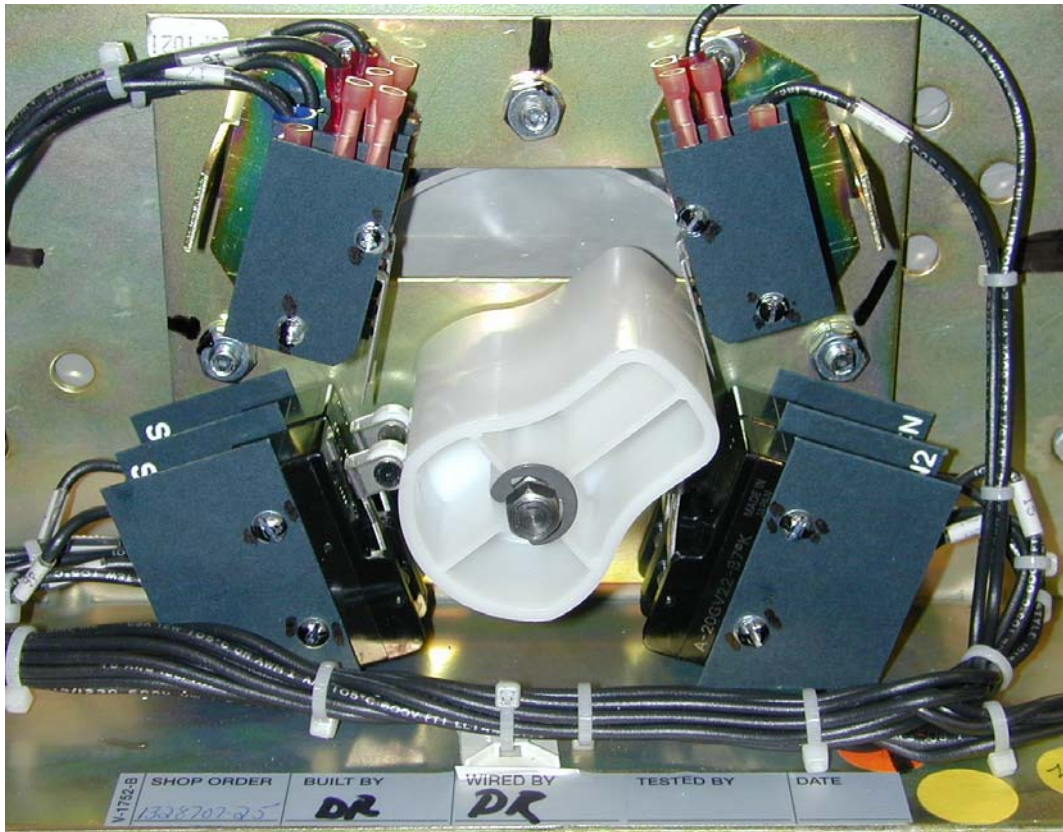


Figure 10.

27. Remove the rectifier assembly wires 206, 209, 306, and 307.



Figure 11.

28. Remove the power harness.

29. Install the new power harness.

GE ZENITH Controls

30. *Connect* the rectifier assembly wires 206, 209,306, and 307.

Note: Ensure that the DC wires going from the solenoid to the DC terminals of the rectifier. The DC section of the rectifier has the red dot. The terminals are lower left and upper right corners.



Figure 12.

GE ZENITH Controls

31. Connect wires 252A, 25ZZ, 26, 36, SN and SE to the micro switch.

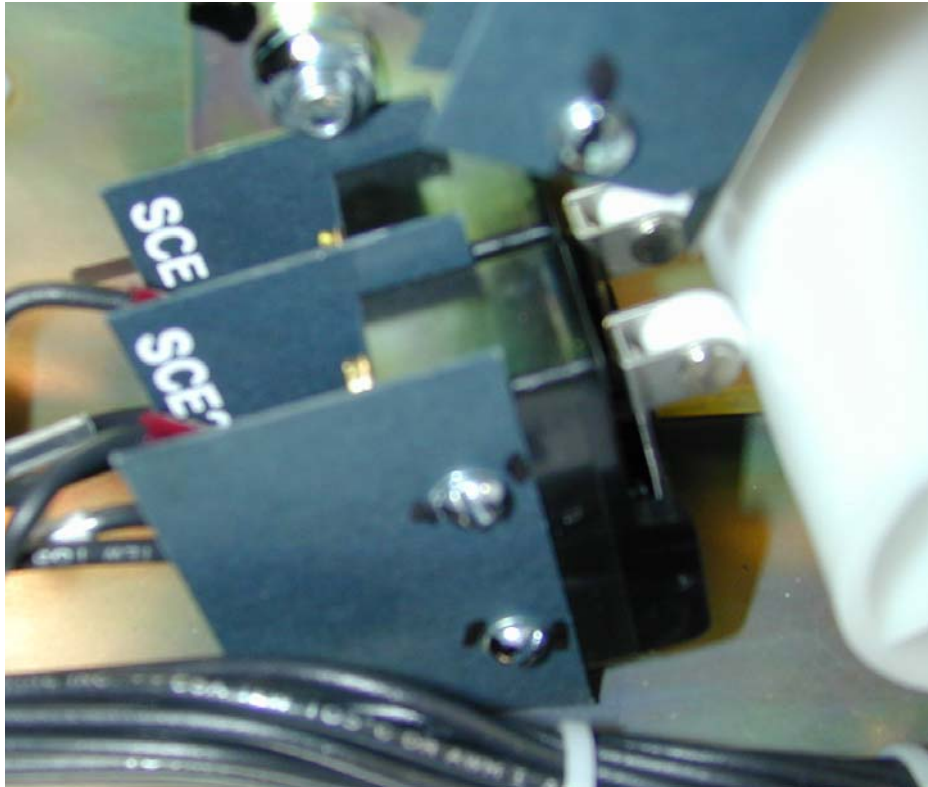


Figure 13.

32. Connect the power lug wires. To the power lugs.

33. Connect the wires to the disconnect switch.

34. Install the disconnect switch.

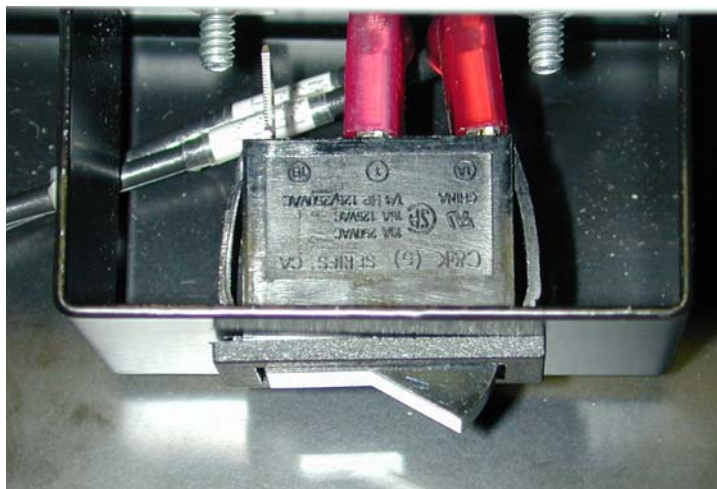


Figure 14.

35. Place the disconnect switch to inhibit.

GE ZENITH Controls

36. *Install* tie wraps as required.

37. *Clean* the inside of the cabinet.

38. *Install* the J6, J,7 and J8 to the micro processor and RT box.

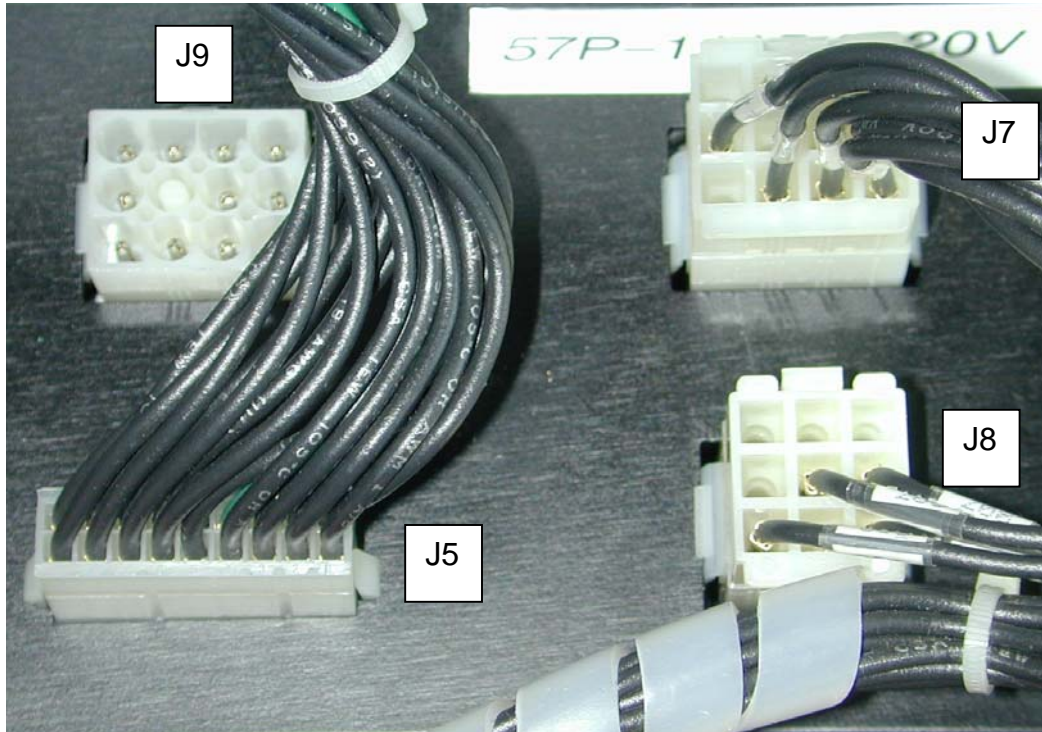


Figure 15.

39. *Install* Tie Wraps as needed to secure the harness.

40. *Connect* the generator start wires.

41. *Place* the disconnect switch to “Auto” position.

42. *Close* the front cover.

43. *Energize* the ATS

44. *Enable* the genset to start automatically after the U-timer (cool-down) has timed out.

45. *Push and hold* the test pushbutton.

Note: After the time delay switch should automatically transfer to the emergency position.

GE ZENITH Controls



Figure 16.

46. *Release* the test pushbutton.

Note: Once you release the test pushbutton and after the time delay, the ATS should return to the normal position.

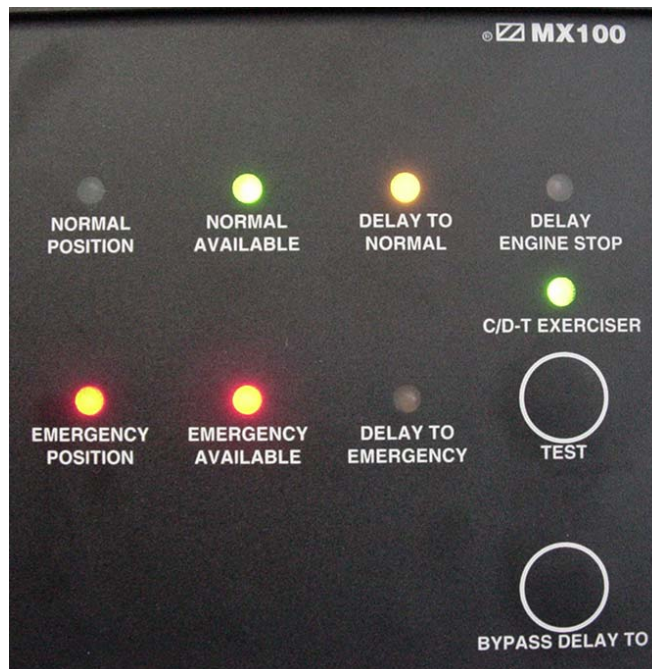


Figure 17.

47. *Clean-up* the area.

GE ZENITH Controls

48. *Complete* the Service Report.

49. *Send* Reports to GE Zenith Controls.

You know you are completed when:

- The transfer switch is secured and operating properly.
- The tools are stored.
- The reports are completed.